

TRANSFORMER OIL TEMPERATURE MONITORING WITH AUTOMATIC CIRCUIT BREAKER

Karthik Parihar*

Devesh Singh Pangtey*

Bharat Singh Rana*

ABSTRACT

Transformers are a vital part of the transmission and distribution system. Monitoring transformers for problems before they occur can prevent faults that are costly to repair and result in a loss of service. Current systems can provide information about the state of a transformer, but they are either offline or very expensive to implement. The system based on PIC Microcontroller has been designed to monitor the transformer's oil temperature continuously throughout its operation. If the Microcontroller recognizes oil temperature violates the limit then the entire unit is shutdown by the designed controlling unit. And also the systems display the values throughout the process for user's reference and further inform the current status of the transformer. Thus, the system makes the transformer more secure, intelligent and robust.

Keywords--- *Microcontrollers, Transmission & Distribution System, Transformers.*

*Department of Electrical Engineering, College of Engineering Roorkee, Roorkee, Uttarakhand, India

I. INTRODUCTION

New modern electronic technologies motivate the creation of new generation of transformers as intelligent devices for advanced distribution automation in future . The Power transformer is essential equipment of the Electrical power system. Usually power transformers have a 20-35 year design life. In practice, a transformer can reach 60 years of useful life if it is properly operated and maintained. With the normal aging, their internal condition degrades, which increases the risk of failure. Traditionally, the evolution of these faults was accompanied with preventative maintenance programs combined with regular tests. With deregulation, it has become necessary to reduce maintenance costs and equipment inventories, thus there is a trend in the industry to move from traditional time-based maintenance programs to condition based maintenance .

This paper presents a monitoring system for integrated diagnosis of power transformers. The monitoring system can be integrated into the plant controlled system allowing smooth operation and reduce interfaces between different systems.

The equipment is permanently mounted on the transformer and is online. The system is made up of static controllers hence it needs less maintenance. And also it helps to cut transformers operational and maintenance cost. The system is modular and expandable for additional requirements that may be needed in future. The ultimate objective is to monitor the electrical parameters and to inform the observed data to the concerned official

II.ASSESSMENT OF POWER TRANSFORMER IN SERVICE

- In practice, life assessment of the transformer may be performed for any of the following reasons [12]:
- To monitor the transformer condition and possibly detect incipient faults;
- To diagnose problems when a transformer exhibits danger signals or following the operation of their protection devices;
- To determine whether a transformer is in condition to cope with unusual operating conditions;
- To obtain reference results to assist in the interpretation of subsequent tests;
- To assist in planning the replacement strategy for a population of transformers;
- To satisfy the requirements for insurance cover;

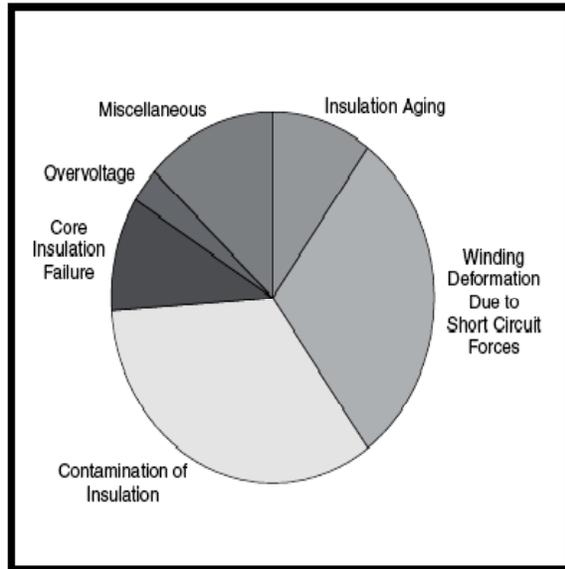


Figure 1. failure statistics of transformer

Failure statistics of large transformers can be beneficial in determining which component is more important to evaluate the condition of the equipment. Figure shows the results of a failure analysis carried out in South Africa, from 188 power transformers in the voltage and power range of 88kV to 765kV and 20MVA to 800MVA, respectively.

For the development of transformers diagnostic tools, it has been essential to undertake a survey about the transformer main components, the associated defects and their diagnostic methods:

A. Traditional Diagnostic Methods

1. Dissolved Gas Analysis: By means of this analysis, it is possible to distinguish faults such as partial discharge, overheating and arcing in a great variety of oil filled equipment.

2. Insulating Oil Quality: A combination of electrical, physical and chemical test is performed to measure the change in electrical properties, extend of contamination and the degree of deterioration in the insulating oil.

3. Thermograph: This method is used to check external temperature of a transformer on line.

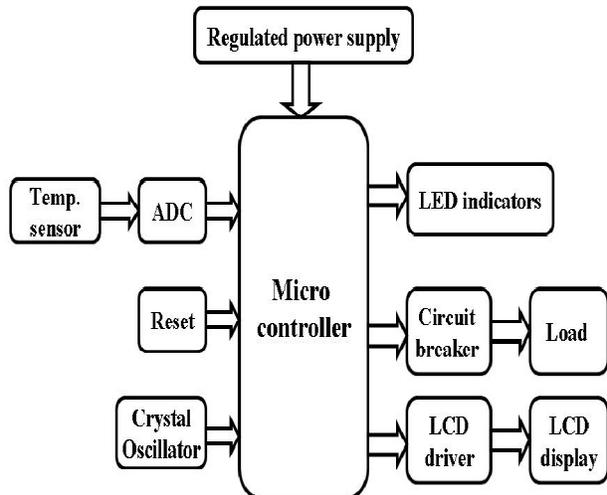


Figure 2 block diagram of proposed monitoring system

III. MONITORING SYSTEM

The Proposed monitoring system shown in Figure 2 is designed using PIC (Peripheral Interface Controller) Microcontroller. The system consist of Sensing units temperature sensors, which collects the essential parameters ssuch ass oil temperature and overload condition within the transformer. The digital display connected to the processing unit displays corresponding parameter values for any technical operations. The microcontroller is programmed in such a manner so as to continuously scan the transformer and update the parameters at a particular time interval. The scanned values are directly given to one of the input port of PIC microcontroller. Along with this, the display is connected to another input port whereas voice informer unit is connected to the output port. The microcontroller is connected to LCD and output port through their respective interfacing ICs.

Features

Lcd interfacing

The lcd interfacing will provide the user interface and all updates regarding the temperature of the oil hence decreasing human effort.

Led indicators

During any incipient faults the overloading of the transformer oil will be indicated by glowing leds connected via microcontroller.

Automatic circuit breaker

Use of a em based circuit breaker will provide proper shutdown of the system during any overloading condition automatically.

Software's used:

1. PIC-C compiler for Embedded C programming.
2. PIC kit 2 programmer for dumping code into Micro controller.
3. Express SCH for Circuit design.
4. Proteus for hardware simulation

IV. CONCLUSION

Transformer diagnostics is an expanding field of study. The monitoring system presented in this paper can be altered and expanded to provide more and more valuable information on the health of a transformer. The potential of this system is vast and with further investigation, the concept of an intelligent diagnostic for transformer or even substation level can be realized. The result of this paper, which is designed for monitoring essential parameters of the transformer, shows great promise on being a successful monitoring system for high voltage transformers. The proposed design of the system makes the distribution transformer more robust against some key power quality issues which makes the voltage, current or temperature to peak. Hence the distribution is made more secure, reliable and efficient by means of the proposed system.

V.ACKNOWLEDGMENT

The authors would like to thank the project coordinator for providing the necessary support, facilities and encouragement to carry out this work. We are also grateful to our HOD and our project Guide for their support and valuable suggestions.

VI.REFERENCES

- [1] Alessandro Ferrero, "Measuring electric Power quality: Problems and Perspectives", Measurement Vol.41, No.2, pp 121-129, Feb 2008.
- [2] Jyotishman Pathak, Yuan Li, Vasant Honavar and JamesD.McCalley, "A Service-Oriented Architecture for Electric Power Transmission System Asset Management", In ICSOC Workshop, pp 26-37, 2006.
- [3] Morais D.R, Rolim J.G and Vale Z.A, "DITRANS-A Multiagent system for integrated diagnosis of Power Transformer", Power Tech IEEE Lausanne, pp 1917-1922,July 2007.

- [4] Naresh.R, Veena Sharma and Manisha vashisth, “An Integrated Fuzzy approach for fault diagnosis of Transformers”, IEEE Transactions on Power Delivery, Vol 23, No.4, pp 2017-2024, Oct 2008.
- [5] Negenborn.R.R, Beccti.A.G, Demiray.T, Leirens.S, Damm.G, DeSchutter.B and Morari.M, “Supervisory hybrid model predictive control for voltage stability of power networks”, Proceedings of the 2007 American Control Conference, New York, pp: 5444-5449, July 2007.
- [6] Overby and Weber, “Visualization of power system data”, in proceedings of 33rd annual Hawaii international conference on system science, Jan 2000.
- [7] Pudlo.G, Tenbohlen.S, Linders.M and Krost.G, “Integration of Power Monitoring and overload calculation into the power system control surface”, IEEE/PES Transmission and Distribution Conference and Exhibition, Vol: 1 pp 470-474, 2002.
- [8] Richard Zurawski, “Embedded systems Handbook”, Published by CRC Press, ISBN, 2006.
- [10] Steve Heath, “Embedded systems Design”, Published by Butterworth-Heinemann, second edition, 2003.
- [9] Thiagarajan and Palanivel, “An efficient monitoring of substations using microcontroller based monitoring system”, International Journal of Research and Review of Applied Science, Vol: 4, No.1 pp 6368, July 2010.
- [10] Wang.M, Vandermaar A.J and Srivastava K.D, “Review of condition assessment of Power Transformer in service”, IEEE Electrical insulation magazine Vol: 18, No.6, pp 12-25, Nov-Dec 2002.
- [11] Xiaomeng Li and Ganesh K.Venayagamoorthy, “A Neural Network based Wide Area Monitor for a Power System”, IEEE Power Engg Society General meeting, Vol: 2, pp: 1455-1460, 2005